


\* COMMUNICATION/SIGNAL TYPE ATTACHMENT

- TELEPHONE CABLE
- CATV CABLE
- ALARM CABLE (FIRE, POLICE, WATER TOWER LEVEL, ETC.)
- TRAFFIC SIGNAL CONTROL CABLE
- TELEGRAPH CABLE
- PUBLIC OR PRIVATE COMMUNICATION CABLE

NOTES:

1. WHEN CATV AND TELEPHONE ARE ATTACHED TO POLE, CATV's PREFERRED POSITION IS ABOVE TELEPHONE (12" MIN.). IF OTHER COMMUNICATION/SIGNAL TYPE CABLES ARE ATTACHED TO POLE WITH CATV AND/OR TELEPHONE, THEIR POSITION SHALL BE MUTUALLY AGREED UPON. 12" SPACING SHOULD BE MAINTAINED BETWEEN CABLES. CATV AND TELEPHONE DROPS CAN BE LESS THAN 12" FROM OTHER CABLES. DROPS SHALL BE 40" BELOW POWER NEUTRAL OR SECONDARY AT POLE.
2. ALL CABLES SHALL BE ON SAME SIDE OF POLE.
3. MESSENGER STRAND SHALL BE BONDED TO THE POLE GROUND, IF PRESENT.

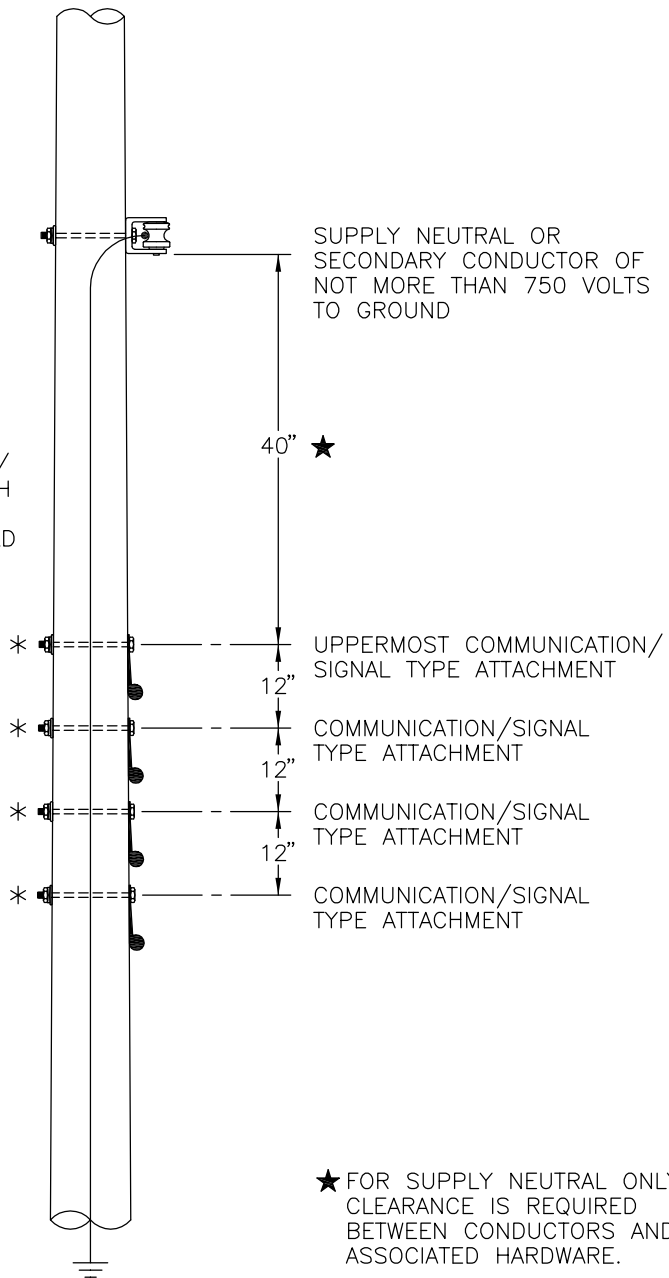

Engineer: JBW  
 Drawn: BLP  
 Checked: ECM  
 Approved: \_\_\_\_\_  
 Date: 10-09-07

SUBJECT: OVERHEAD DISTRIBUTION  
 DETAIL: JOINT USE  
MULTIPLE COMMUNICATION TYPE ATTACHMENTS

NO.	DATE	REVISION
1		
2		
3		



Orlando Utilities  
Commission

OH10-04.001