



OWNED & MAINTAINED BY O.U.C.      OWNED & MAINTAINED BY CUSTOMER

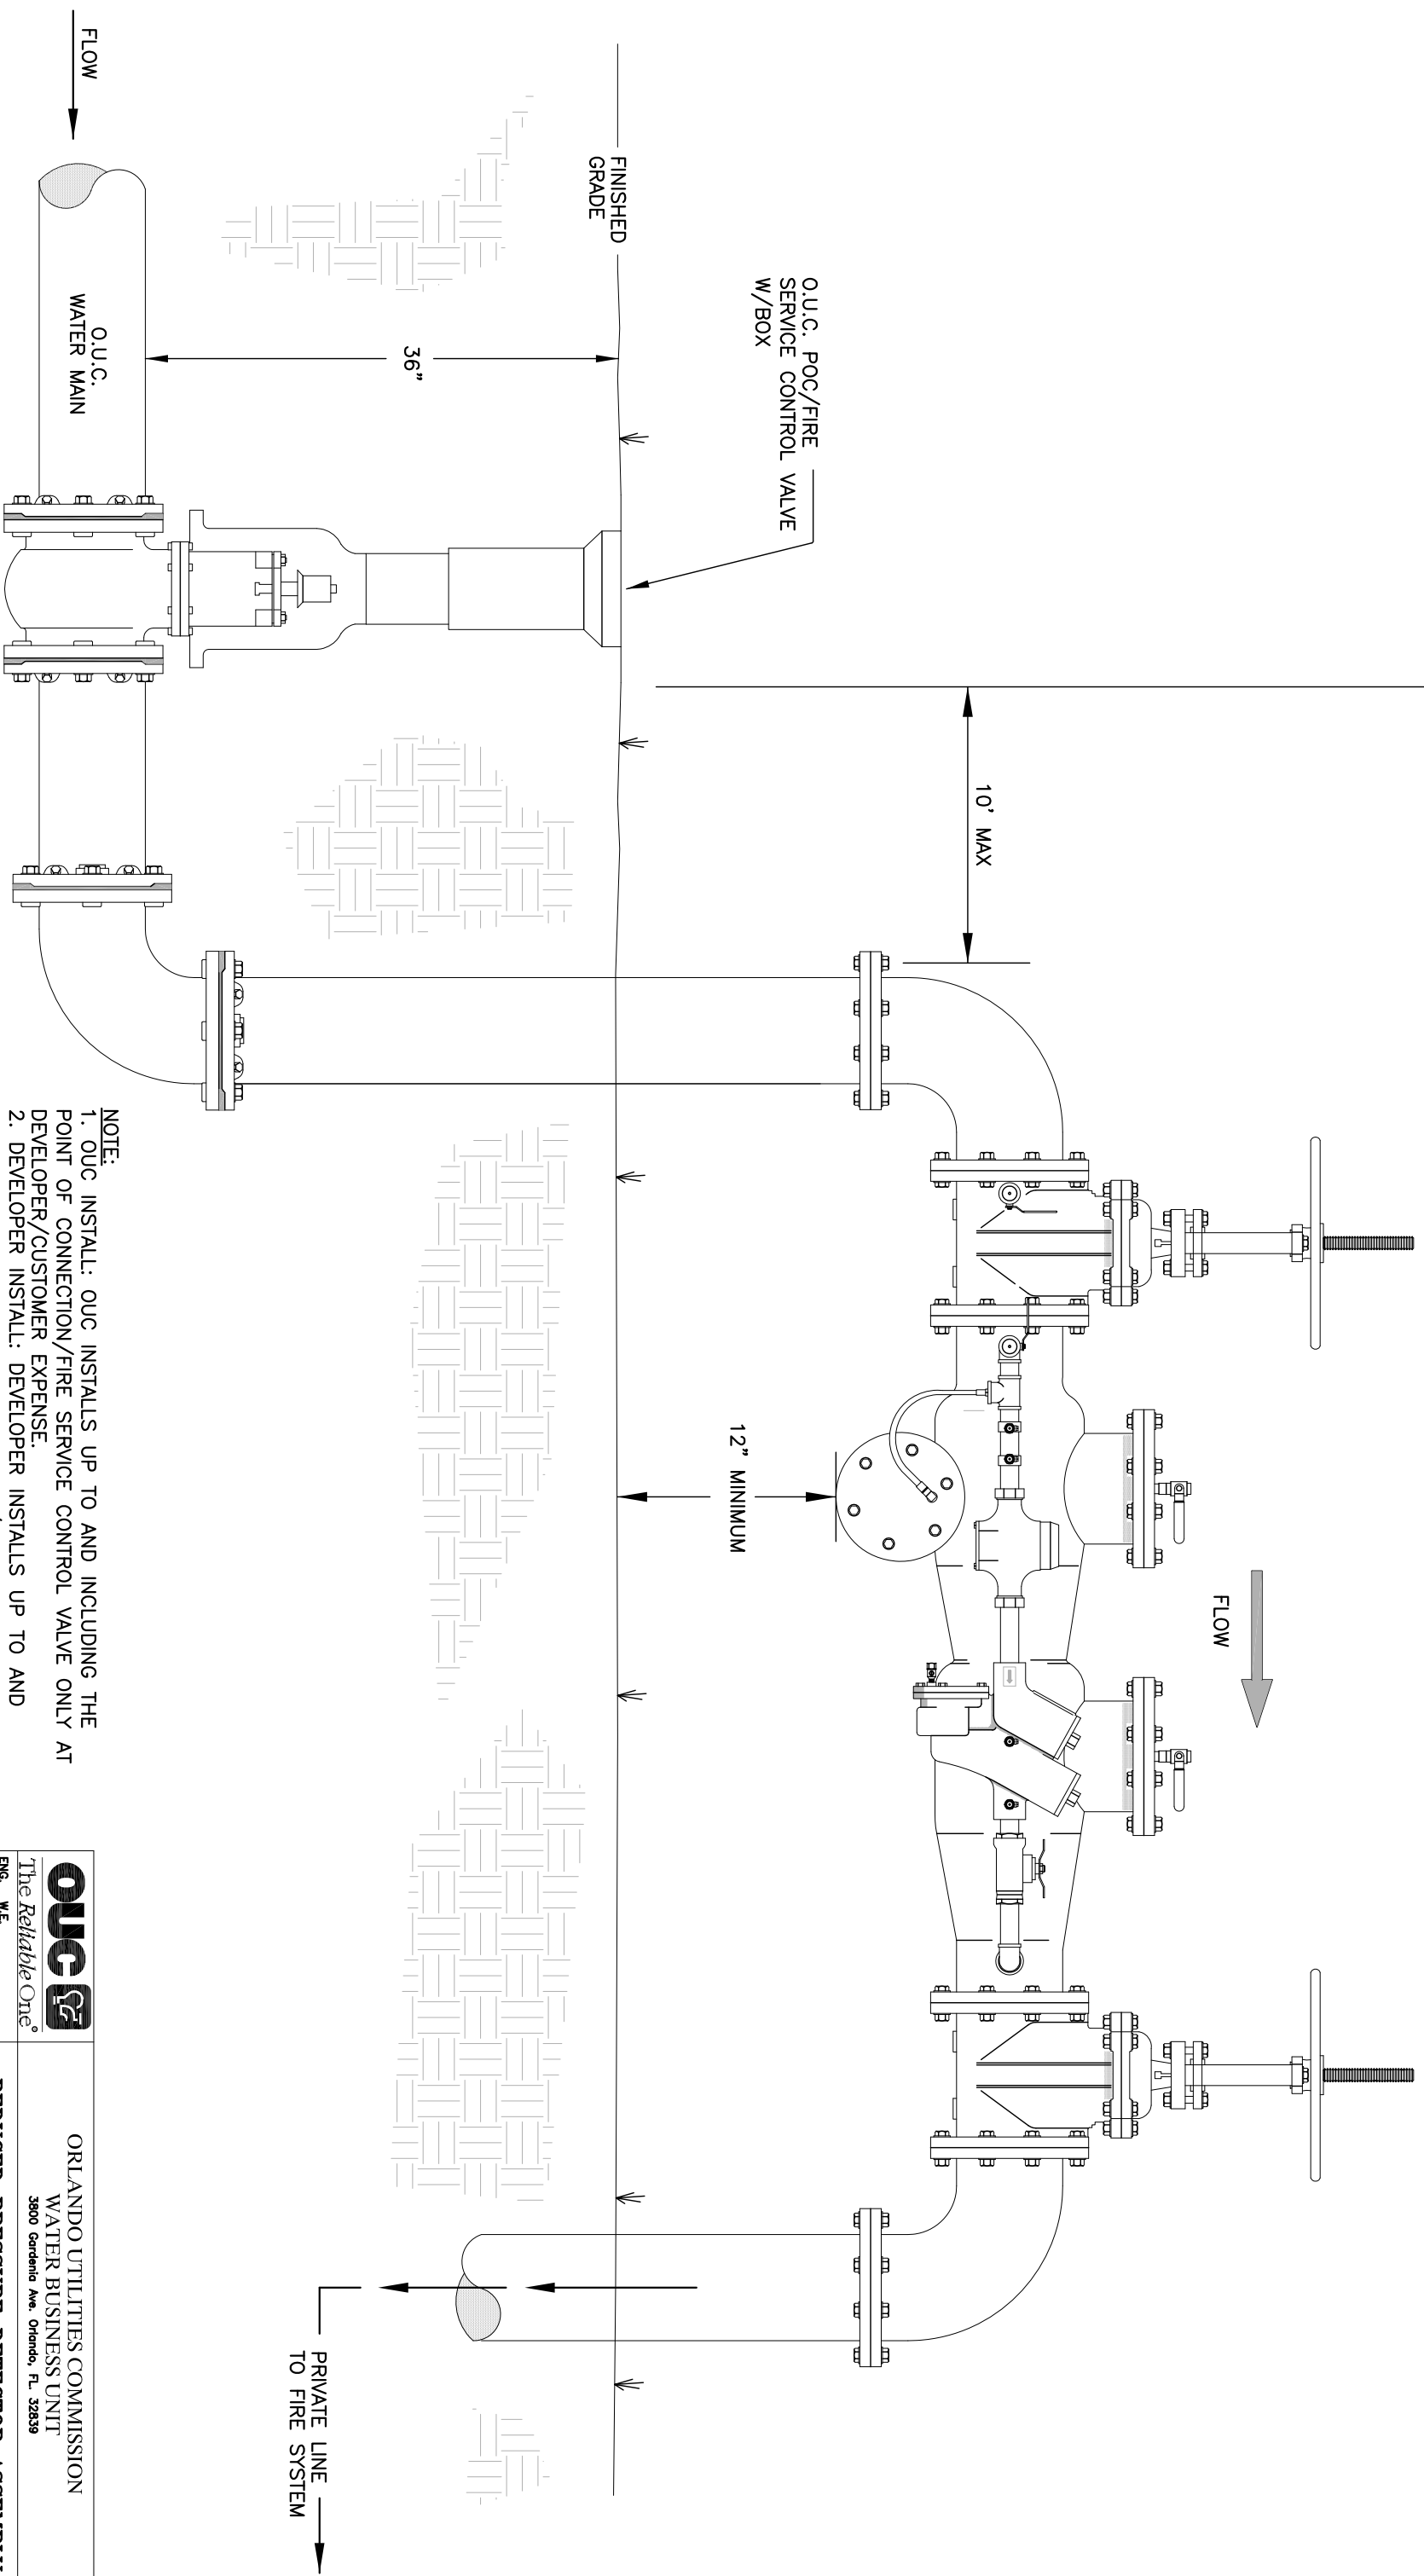

- NOTE:**
1. OUC INSTALL: OUC INSTALLS UP TO AND INCLUDING THE POINT OF CONNECTION/FIRE SERVICE CONTROL VALVE ONLY AT DEVELOPER/CUSTOMER EXPENSE.
  2. DEVELOPER INSTALL: DEVELOPER INSTALLS UP TO AND INCLUDING THE POINT OF CONNECTION/FIRE CONTROL VALVE AT DEVELOPER/CUSTOMER EXPENSE.
  3. OUC APPROVED RPDA INSTALLED, OWNED AND MAINTAINED BY THE DEVELOPER/CUSTOMER.
  4. O.U.C. MATERIALS ARE NOT TO BE REMOVED OR ALTERED.
  5. O.U.C CROSS-CONNECTION DEPARTMENT 407 434-2535

		<b>ORLANDO UTILITIES COMMISSION</b> WATER BUSINESS UNIT 3800 Gardenia Ave. Orlando, FL 32839	
ENG. W/E		<b>REDUCED PRESSURE DETECTOR ASSEMBLY</b> <b>WITH MONITORING METER</b> <b>FOR FIRE SERVICE</b> <b>SIZES: 4"-6"-8"-10"</b>	
DRAWN W/E			
DATE	03-30-09		
W/R. No.	N/A		
ACAD No.	N/A		
SCALE	N.T.S.	FILE	RPDA-TYPICAL.DWG
		MAP SEC.	N/A